


DTK-RM SERIES

MULTI- PORT PATCH PANEL VIDEO SURGE SUPPRESSOR

INSTALLATION INSTRUCTIONS

NOTE: THIS DEVICE IS INTENDED TO BE INSTALLED INDOORS ON THE EQUIPMENT RACK CLOSEST TO THE POINT OF USE.

1. TEST CIRCUIT PRIOR TO INSTALL TO VERIFY CORRECT OPERATION.
2. MOUNT THIS PANEL IN AN EXPOSED SLOT OF A 19" EQUIPMENT RACK.
3. CONNECT TO EQUIPMENT GROUND USING THE GROUND LUG PROVIDED ON REAR OF FACEPLATE. USE A MINIMUM OF 14 AWG WIRE.
4. MAKE SURE THE WIRE DISTANCE FROM THE SURGE PROTECTOR TO PROTECTED EQUIPMENT IS GREATER THAN THE WIRE DISTANCE FROM THE SURGE PROTECTOR TO GROUND.
5. CONNECT THE BNC CABLE FROM THE FIELD OR SUPPLY WIRING INTO THE INPUT (IN) AT THE TOP ROW OF THE PATCH PANEL.
6. INSERT THE BNC CABLE TO THE EQUIPMENT TO BE PROTECTED INTO THE OUTPUT (OUT) AT THE BOTTOM ROW of the PATCH PANEL.
7. IF YOU HAVE ANY QUESTIONS PERTAINING TO THIS UNIT, CALL TECHNICAL SUPPORT AT: 1-888-472-6100.

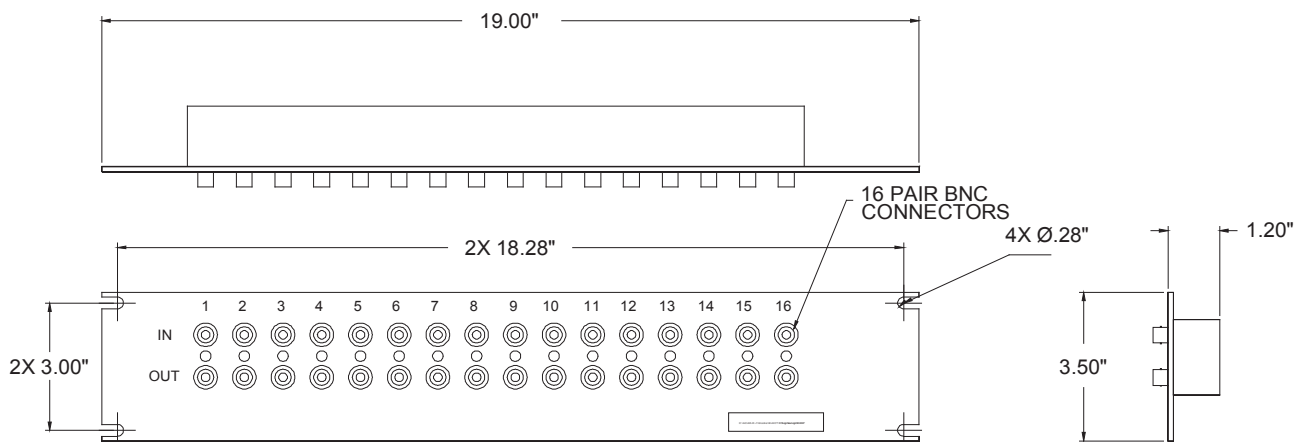

Diversified Technology Group, Inc.

1720 Starkey Road Largo, Florida 33771
Tel. 727-812-5000 Fax 727-812-5026

TITLE: INSTALLATION INSTRUCTIONS DTK-RM SERIES

MATERIAL:

APPROVED BY:

FINISH:

DRAWN BY:

DATE:

REVISED:

DWG NO.

PART NO.

REV.

RWM

5-2-03

7-24-03

INT-100060-001

191045

2